

Modicon Quantum Automation Series 140 CPU 534 14A Instruction Sheet

31002658 02

Version 3.0

Important Information

What is an "A" Version CPU

The obsolescence of parts has necessitated a redesign of the Quantum Automation Series 140 CPU 534 14 controller. This redesigned version of the controller will be designated with "A" at the end of the part number (i.e., 140 CPU 534 14A). This version is functionally identical to the standard version (non-"A"), however, the following should be considered.

- If you are using the module in a hot standby topology, then you **must** use either two non-"A" models or two "A" models.
- The "A" version has a unique flash executive.



Note: The "A" and non-"A" flash executives are **not** interchangeable.

- Schneider Automation software (Concept, ProWORX, and Modsoft) supports the "A" version. Any existing or new 140 CPU 534 14 program configuration will load into a 140 CPU 534 14A without any modifications.

For More Information

For complete information concerning this and other modules, please obtain a copy of the *Quantum Automation Series Hardware Reference Guide* (840 USE 100 00) from your distributor or local sales office.


Front Panel Topology

Overview of the Front Panel Switches

There are two switches (a three-position slide switch and a three-position key switch) and one connector (Modbus RS-232) located on the front of the CPU. These switches are described in the following sections.

Front Panel Slide Switch

The slide switch is used to select the comm parameter settings for the Modbus (RS-232) ports. Three options are available.



- Setting the slide switch to the top position assigns ASCII functionality to the port; the following comm parameters are set and cannot be changed.

ASCII Comm Port Parameters	
Baud	2,400
Parity	Even
Data Bits	7
Stop Bits	1
Device Address	Rear panel rotary switch setting

Front Panel Topology, continued

Front Panel Slide Switch, continued

- Setting the slide switch to the middle position assigns remote terminal unit (RTU) functionality to the port; the following comm parameters are set and cannot be changed.


RTU Comm Port Parameters	
Baud	9,600
Parity	Even
Data Bits	8
Stop Bits	1
Device Address	Rear panel rotary switch setting

- Setting the slide switch to the bottom position gives you the ability to assign comm parameters to the port in software; the following parameters are valid.

Valid Comm Port Parameters		
Baud	19,200	1,200
	9,600	600
	7,200	300
	4,800	150
	3,600	134.5
	2,400	110
	2,000	75
	1,800	50
Data Bits	7 / 8	
Stop Bits	1 / 2	
Parity	Enable/Disable Odd/Even	
Device Address	1 ... 247	

Front Panel Topology, continued

Front Panel Key Switch The key switch is used to protect memory from programming changes while the controller is in operation.

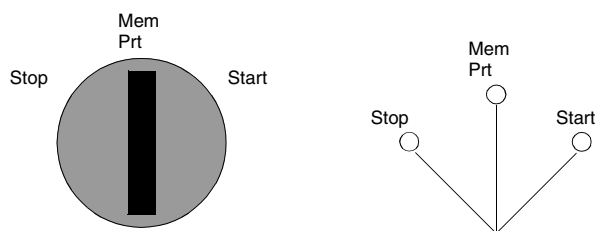


Key switch Position	Controller Status	Memory Protected From Programmer Changes	Will Accept Programmer Stop or Start	Key switch Transition
Stop	Controller is stopped and disables Programmer changes	Y	N	From Start or Memory Protect: Stops controller, if running, and disables Programmer changes
Memory Protect	Controller may be either stopped or running and Programmer changes are disabled	Y	N	From Stop or Start: Prevents Programmer changes, controller run status is not changed
Start	Controller may be either stopped or running, Programmer may make changes and start/stop the controller	N	Y	From Stop: Enables Programmer changes, starts controller. From Memory Protect: Enables programmer changes, starts controller if stopped

Front Panel Topology, continued

Front Panel Modbus Connector

The Quantum 140 CPU 534 14A is equipped with two nine-pin RS-232C connectors that support Modicon's proprietary Modbus communication protocol. The following is the Modbus port pinout connections for nine-pin and 25-pin connections.

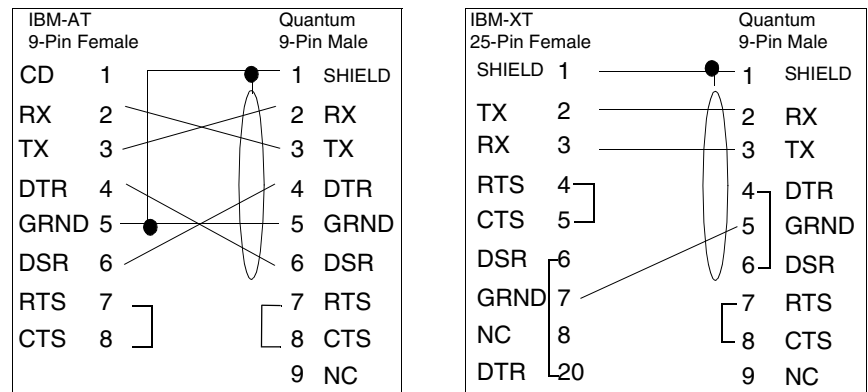

TX: Transmitted Data	DTR: Data Terminal Ready
RX: Received Data	CLS: Clear to Send
RTS: Request to Send	N/C: No Connections
DSR: Data Set Ready	CD: Carrier Detect



Note: Although the Modbus ports electrically support existing Modbus cables, it is recommended that a Modbus programming cable (Part # 990 NAA 263 20) be used. This cable has been designed to fit under the door of a Quantum CPU or NOM module..

Rear Panel Topology

Overview of the Rear Panel Switches




Two rotary switches (refer to the illustration and table below) are located on the rear panel of the CPU. They are used for setting Modbus Plus node and Modbus port addresses.

Note: The highest address that may be set with these switches is 64..

SW1 (the top switch) sets the upper digit (tens) of the address; SW2 (the bottom switch) sets the lower digit (ones) of the address. The illustration below shows the correct setting for an example address of 11.

SW1 and SW2 Address Settings		
Node Address	SW1	SW2
1 ... 9	0	1 ... 9
10 ... 19	1	0 ... 9
20 ... 29	2	0 ... 9
30 ... 39	3	0 ... 9
40 ... 49	4	0 ... 9
50 ... 59	5	0 ... 9
60 ... 64	6	0 ... 4

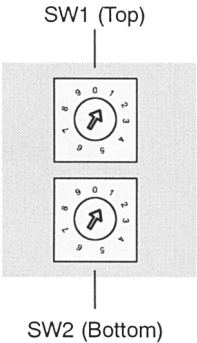

Note: If 0" or an address greater than 64 is selected, the Modbus + LED will be "ON" steady, to indicate the selection of an invalid address..

Option Module Interface Support

Overview The 140 CPU 534 14A supports up to six network modules (i.e., Modbus Plus, Ethernet, and Multi-Axis Motion option modules) using the option module interface technique. However, only two Modbus Plus modules can have full functionality, including Quantum DIO support.

Quantum Communications and Network Modules The following table lists the Quantum communications and networking modules.

Model Number	Description	Module Interface Technique	Loadable Required	Backplane Support			Bus Power mA
				Local	RIO	DIO	
140CRP81100	Profibus	Direct CPU Driver	N	Y	N	N	1200
140CRP93100	Remote I/O Head Interface, single cable	Direct CPU Driver	N	Y	N	N	780
140CRP93200	Remote I/O Head Interface, dual cable	Direct CPU Driver	N	Y	N	N	780
140CHS21000	Hot Standby Processor Kit	Direct CPU Driver	Y	Y	N	N	700
140NOA61110	Interbus Master	Direct CPU Driver	Y	Y	N	N	700
140NOM21100	Modbus Plus Options, single cable	Option Module	N	Y	N	N	780
140NOM21200	Modbus Plus Option, dual cable	Option Module	N	Y	N	N	780
140NOM25200	Modbus Plus Option, single channel fiber	Option Module	N	Y	N	N	900
140NOE21100	Ethernet TCP/IP Twisted Pair	Option Module	N	Y	N	N	1000
140NOE25100	Ethernet TCP/IP Fiber Optic	Option Module	N	Y	N	N	1000
140NOE31100	Ethernet SY/MAX Twisted Pair	Option Module	N	Y	N	N	1000

Option Module Interface Support, continued

Quantum Communications and Network Modules, continued

Model Number	Description	Module Interface Technique	Loadable Required	Backplane Support			Bus Power mA
				Local	RIO	DIO	
140NOE35100	Ethernet SY/MAX Fiber Optic	Option Module	N	Y	N	N	1000
140NOE5100 ¹	Ethernet MMS Twisted Pair	Option Module	N	Y	N	N	1000
140NOE55100 ¹	Ethernet MMS Fiber Optic	Option Module	N	Y	N	N	1000
140MMS42500	Multi-Axis Motion Controller w/SERCOS	Option Module	N	Y	N	N	2500
140NOL91100	LonWorks Interface, twisted pair FTT10	I/O Map (16/16)	Y	Y	Y	N	950
140NOL91110	LonWorks Interface, twisted pair TPT/XF-78	I/O Map (16/16)	Y	Y	Y	N	950
140NOL91120	LonWorks Interface, twisted pair TPT/XF-1250	I/O Map (16/16)	Y	Y	Y	N	950
1. The software for this module is a ModConnect product.							

Option Module Interface Support, continued

Quantum Modbus and Modbus Plus Services

This table describes the types of services provided by Modbus and Modbus Plus.

Type	Service Description	Native CPU Ports		NOM 1-2 Ports		NOM 3-6 Ports ¹	
		Modbus	Modbus Plus	Modbus	Modbus Plus	Modbus	Modbus Plus
Modbus Services	Default Modbus Port Parameters	Y	-	Y	-	Y	-
	Configurable Modbus Port Parameters	Y	-	Y	-	Y ⁵	-
	Modbus to Modbus Plus Bridging	Y ²	-	Y ³	-	Y ³	-
	Local CPU Programming	Y ⁴	-	Y ⁴	-	N	-
	Remote CPU Programming over Modbus Plus	Y ⁴	-	Y ⁴	-	Y ²	-
	Modbus access to local CPU	Y	-	Y	-	N	-
	Modbus access to remote CPU over Modbus Plus	Y	-	Y	-	Y	-
	Modbus Network Slave Support	Y	-	N	-	N	-
	Modbus Master support with XMIT Loadable	Y	-	N	-	N	-
	Executive Firmware Loading Support	Y	-	N	-	N	-
<ol style="list-style-type: none"> 1. Only supported on the 140CPU42402, 140CPU43412A and 140CPU53414A Quantum Controllers. 2. The native CPU Modbus port can be disabled from bridge mode operation with the native Modbus Plus Port. 3. Modbus ports on NOMs are always in bridge mode with their associated Modbus Plus port. 4. Only one programmer connection can be logged in at a time to any CPU, and only one program monitor can be attached at a time to any CPU. 5. Modbus port parameters on NOMs 3-6 are defined by Modbus Port 3 in Concept and Modsoft when the comm parameter selector switch is in mem. 							

Option Module Interface Support, continued

Quantum Modbus and Modbus Plus Services, continued

Type	Service Description	Native CPU Ports		NOM 1-2 Ports		NOM 3-6 Ports ¹	Modbus Plus
		Modbus	Modbus Plus	Modbus	Modbus Plus	Modbus	Y
Modbus Plus Services	MSTR read/write register messaging ²	-	Y	-	Y	-	Y
	MSTR read/write Global Data messaging	-	Y	-	Y	-	Y
	MSTR get/clear local/remote statistics	-	Y	-	Y	-	Y
	Config Extension Global Data Support	-	Y	-	Y	-	N
	Config Extension Peer Cop Support	-	Y	-	Y	-	N
	Distributed I/O Support	-	Y	-	Y	-	N
	CPU Programming	-	Y ³	-	Y ³	-	Y ³
	Executive Firmware Loading Support	-	Y	-	N	-	N
<ol style="list-style-type: none"> Only supported on the 140CPU42402, 140CPU43412A and 140CPU53414A Quantum Controllers. Up to 4 MSTR read/write register instructions can be serviced per CPU scan per Modbus Plus port. Only one programmer connection can be logged in at a time to any CPU, and only one program monitor can be attached at a time to any CPU. 							

140 CPU 534 14A Module Specifications

140 CPU 534 14A Specifications The following table provides you with the specifications for the 140 CPU 534 14 module.

User Logic/Reference Capacity	User Logic	Discrete	Register	Extended Register	IEC Application Memory
	64 k words	64 k	57 k *	96 k	2.5 M
	* 57,766 4XX registers				
	Only if 0XXX = 16 and				
	1XXX =16 and				
	3XXX =16				
Reference Capacity					
Discrete	64 k - any mix				
Local I/O (Main Backplane)					
Maximum I/O Words	64 In and 64 Out *				
Maximum Number of I/O Racks	1				
Remote I/O					
Maximum I/O Words per Drop	64 In and 64 Out *				
Maximum Number of Remote Drops	31				
Distributed I/O					
Maximum Number of Networks per System	3 **				
Maximum Words per Network	500 In and 500 Out				
(For every DIO drop, there is a minimum of two words input of overhead.)					
Maximum Words per Node	30 In and 32 Out				
* This information can be a mix of Discrete or Register I/O. for each word of register I/O configured, one word of I/O words must be subtracted from the the total available. The same holds true for each block of 8 bits or 16 bits of Discrete I/O configured-one word of Register I/O must be subtracted from the total available.					
** Requires the use of two 140 NOM 21x 00 Option Modules.					

!40 CPU 534 14A Module Specifications, continued

140 CPU 534 14A Specifications, continued

Maximum Number of Option Module Interfaces	6																
Watchdog Timer	250 ms (S/W adjustable)																
Logic Solve Time	0.1 ms / k to 0.5 ms / k																
Battery	3 V Lithium																
Service Life	1200 mAh																
Shelf Life	10 years with 0.5% loss of capacity per year																
Battery Load Current @ Power-off																	
Typical	14 microamps																
Maximum	420 microamps																
Communication																	
Modbus (RS-232)	2 serial ports (9-pin D-shell)																
Modbus Plus (RS-485)	1 network port (9-pin D-shell)																
Programming Software Compatability	Modsoft Ver. 2.6 Concept Ver. 2.1 with B2.1 patch exec Concept Ver 2.2 with SR2 ProWORX NxT Ver. 2.0 ProWORX Plus Ver. 1.05																
General																	
Diagnostics	<table> <tr> <th><u>Power Up</u></th><th><u>Runtime</u></th></tr> <tr> <td>RAM</td><td>RAM</td></tr> <tr> <td>RAM Address</td><td>RAM Address</td></tr> <tr> <td>Executive</td><td>Executive Checksum</td></tr> <tr> <td>Checksum</td><td></td></tr> <tr> <td>User Logic</td><td>User Logic Check</td></tr> <tr> <td>Check</td><td></td></tr> <tr> <td>Processor</td><td></td></tr> </table>	<u>Power Up</u>	<u>Runtime</u>	RAM	RAM	RAM Address	RAM Address	Executive	Executive Checksum	Checksum		User Logic	User Logic Check	Check		Processor	
<u>Power Up</u>	<u>Runtime</u>																
RAM	RAM																
RAM Address	RAM Address																
Executive	Executive Checksum																
Checksum																	
User Logic	User Logic Check																
Check																	
Processor																	
Bus Current Required	1.25 A																
TOD Clock	+/- 8.0 seconds/day 0 ... 60° C																
Operating Temperature	0 ... 50° C																
Maximum Number of NOM, NOE, and MMS Modules (any combination)	6																